

Satin Aluminum or Powder Coated Finish per Customer Specification.

C BUTT SQ.	D TOP SQ.	F BOLT CIR. DIA.	G BASE SQ.	H BOLT PROJ.	I BOLT SIZE
4	4	8.5 - 9.5	9.875	1.5	.75 x 17 x 3
5	5	10.5 - 11.5	11.25	2	.75 x 30 x 3
6	6	12 - 13	12.75	2.25	1 x 36 x 4
6.625	6.625	13 - 14	13.5	2.25	1 x 36 x 4


Dimensions in Inches

### Pole

The pole shaft will be constructed of seamless extruded tube of 6XXX Series Aluminum Alloy per the requirements of ASTM B221. The shaft assembly shall be full-length heat treated after base weld.

### Base Style

4-Bolt Cast Aluminum Base Flange of Alloy 356-T6 with Aluminum Snap-In Bolt Covers.



### Handhole



4"-5" Butt Squares - 2" x 4" Handhole with square Lap Style Aluminum Door and two (2) Stainless Steel Self-Tapping Attaching Screws. A Grounding Provision incorporating a tapped 1/4"-20NC Grounding Provision is provided opposite the Handhole.



6"+ Butt Square - 3" x 5" Handhole with square Lap Style Aluminum Door and two (2) Stainless Steel Self-Tapping Attaching Screws. A Grounding Provision incorporating a tapped 1/4"-20NC Grounding Provision is provided opposite the Handhole.

### Anchorage

Anchorage Kit will include four (4) L-shaped Steel Anchor Bolts conforming to AASHTO M314-90 Grade 55. Ten inches (10") of threaded end will be galvanized per ASTM A153. Kits will contain four (4) Hex Nuts, four (4) Lock Washers, and four (4) Flat Washers (all components Galvanized Steel). A bolt circle template will be provided.




### Vibration Damper

If determined necessary by Hapco, a top-mount, field installed First Mode Vibration Damper will be provided. Customer specification of the damper is available.

### Mounting Designation

#### Side Drill Mount

For Side Drill Mount applications specify luminaire type, quantity and orientation. A luminaire drilling template must be supplied at time of order.

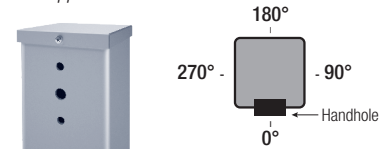

#### Tenon Mount


For Tenon Mount applications specify both Tenon diameter (2.375", 2.875", 3.5", etc.) and length (3", 4", etc.).



A MTG. HGT.	B WALL THICKNESS	C BUTT DIA.	TOTAL LUM. WEIGHT	MAXIMUM EPA								OLD CATALOG NUMBER	CATALOG NUMBER
				120	130	140	150	160	170	180			
08	0.125	4	300	14.9	12.5	10.6	9.0	7.8	6.7	5.9	11-043	SSA08B4-4-**-	
10	0.125	4	251	11.2	9.3	7.8	6.5	5.5	4.7	4.0	11-063	SSA10B4-4-**-	
10	0.188	4	300	17.5	14.6	12.4	10.5	9.0	7.8	6.7	11-064	SSA10D4-4-**-	
12	0.125	4	174	8.8	7.2	5.8	4.8	3.9	3.2	2.6	11-083	SSA12B4-4-**-	
12	0.188	4	249	13.8	11.4	9.5	8.0	6.7	5.7	4.8	11-084	SSA12D4-4-**-	
12	0.188	5	300	26.7	22.2	18.7	15.9	13.6	11.7	10.1	11-087	SSA12D5-4-**-	
14	0.125	4	127	6.8	5.4	4.3	3.4	2.6	2.0	1.5	11-103	SSA14B4-4-**-	
14	0.188	4	182	11.1	9.1	7.4	6.1	5.0	4.1	3.4	11-104	SSA14D4-4-**-	
14	0.188	5	300	21.4	17.7	14.7	12.3	10.3	8.7	7.3	11-107	SSA14D5-4-**-	
15	0.125	4	111	6.0	4.6	3.6	2.7	2.0	1.5	1.0	11-123	SSA15B4-4-**-	
15	0.188	4	158	10.0	8.1	6.5	5.3	4.3	3.5	2.8	11-124	SSA15D4-4-**-	
15	0.188	5	300	19.2	15.7	13.0	10.8	9.0	7.4	6.2	11-127	SSA15D5-4-**-	
16	0.125	4	97	5.1	3.9	2.9	2.1	1.5	0.9	-	11-143	SSA16B4-4-**-	
16	0.188	4	139	8.9	7.1	5.7	4.5	3.6	2.8	2.2	11-144	SSA16D4-4-**-	
16	0.188	5	284	17.2	14.0	11.4	9.4	7.7	6.3	5.1	11-147	SSA16D5-4-**-	
18	0.125	4	76	3.6	2.6	1.7	1.0	-	-	-	11-163	SSA18B4-4-**-	
18	0.188	4	110	6.9	5.3	4.1	3.1	2.3	1.6	1.0	11-164	SSA18D4-4-**-	
18	0.250	4	139	9.8	7.8	6.3	5.0	3.9	3.1	2.3	11-165	SSA18F4-4-**-	
18	0.188	5	224	13.8	11.0	8.8	7.0	5.6	4.3	3.3	11-167	SSA18D5-4-**-	
20	0.125	4	62	2.4	1.4	0.7	-	-	-	-	11-183	SSA20B4-4-**-	
20	0.188	4	89	5.2	3.8	2.8	1.9	1.2	0.6	-	11-184	SSA20D4-4-**-	
20	0.250	4	112	7.8	6.0	4.7	3.5	2.6	1.9	1.2	11-185	SSA20F4-4-**-	
20	0.188	5	181	11.0	8.6	6.6	5.0	3.7	2.7	1.8	11-187	SSA20D5-4-**-	
20	0.250	5	232	15.9	12.7	10.2	8.1	6.5	5.1	3.9	11-188	SSA20F5-4-**-	
20	0.188	6	300	14.8	11.5	8.9	6.8	5.1	3.7	2.6	11-190	SSA20D6-4-**-	
20	0.250	6	300	21.7	17.4	14.0	11.3	9.0	7.2	5.6	11-191	SSA20F6-4-**-	
25	0.188	5	115	5.6	3.7	2.2	1.0	-	-	-	11-247	SSA25D5-4-**-	
25	0.250	5	147	9.3	6.8	4.9	3.4	2.1	1.1	-	11-248	SSA25F5-4-**-	
25	0.188	6	203	7.7	5.2	3.2	1.7	-	-	-	11-250	SSA25D6-4-**-	
25	0.250	6	262	12.6	9.4	6.9	4.8	3.2	1.8	0.6	11-251	SSA25F6-4-**-	
25	0.250	6.625	300	18.2	14.0	10.6	7.9	5.7	3.9	2.3	11-254	SSA25FJ-4-**-	
30	0.250	6	181	6.4	3.8	1.8	-	-	-	-	11-291	SSA30F6-4-**-	
30	0.250	6.625	248	10.1	6.8	4.1	2.0	-	-	-	11-294	SSA30FJ-4-**-	

**Catalog Number System**

The catalog number for Hapco poles utilizes the following identification system.

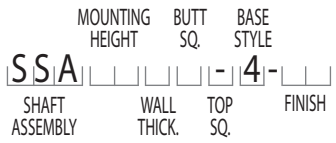

**Catalog Number Example -**

**SSA 20 D 5 - 4 - BA**

Square Straight Aluminum, 20' Mounting Height, .188" Wall Thickness, 5" Butt Square, No Taper, 4-Bolt Base, Black Powder Coat Finish.

**Wall Thickness**

- B = .125"
- D = .188"
- F = .250"

**Butt Square**

- 4 = 4"
- 5 = 5"
- 6 = 6"
- J = 6-5/8"

**Top Square**


- = No Taper

**Base Style**

- 4 = 4-Bolt Base

**Finish**

- BA = Black Powder Coat
- BH = White Powder Coat
- BM = Dark Bronze Powder Coat
- BV = Dark Green Powder Coat
- GC = Gray Powder Coat
- \*\* = Specify Finish

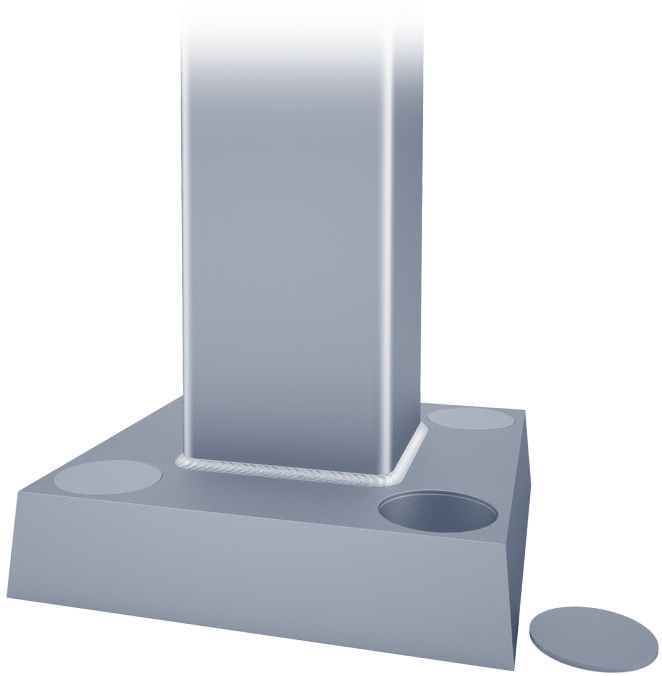


**EPA Note:**

EPA's based on side mounted fixture(s) not exceeding the height of the pole.

# This Hapco Florida Building Code Guide has been developed to provide a quick reference for EPAs (Effective Projected Areas) meeting the 2023 FBC.

The EPAs in this publication are based on the 3-second gust wind map taken from the 2023 Florida Building Code (Figure 1609.3(1); Wind map shown below). These EPAs cannot be used with older or newer maps.

This wind map is to be used in conjunction with ASCE 7 Wind Pressure and AASHTO LTS-6 Design Equations. Wind regions from maps other than the one shown below may not represent the EPA values listed in this catalog. Please contact Hapco for more detailed information about EPA equations.

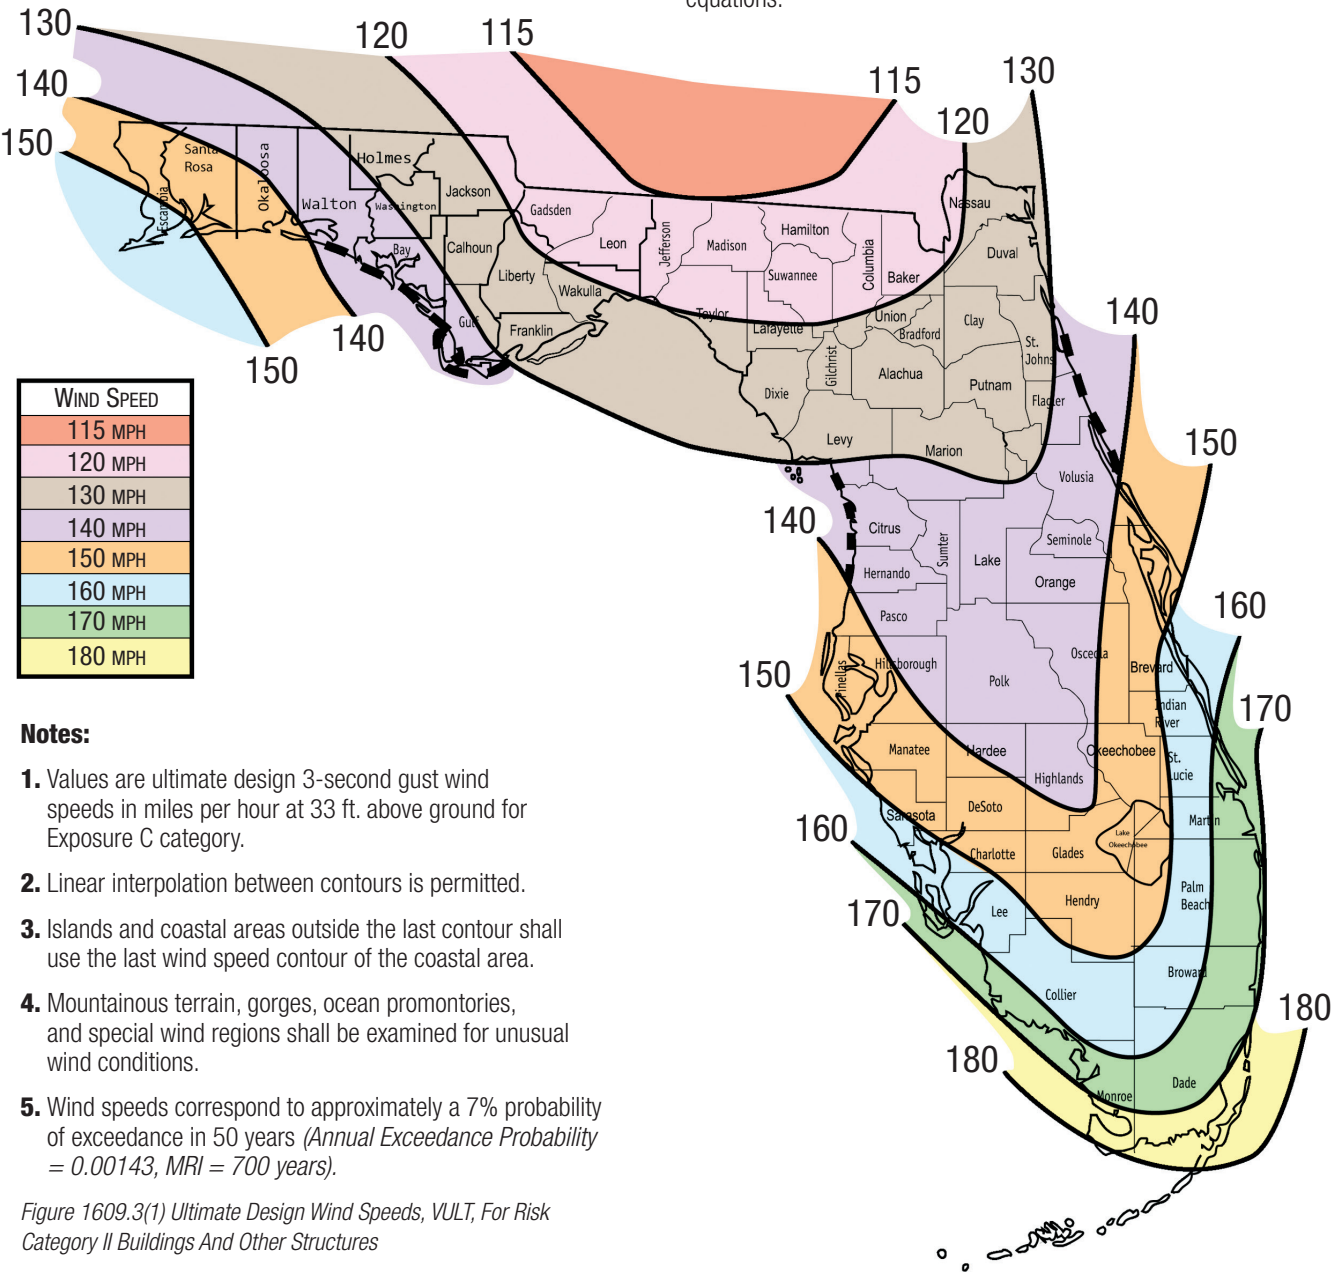

- Notes:**
1. Values are ultimate design 3-second gust wind speeds in miles per hour at 33 ft. above ground for Exposure C category.
  2. Linear interpolation between contours is permitted.
  3. Islands and coastal areas outside the last contour shall use the last wind speed contour of the coastal area.
  4. Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind conditions.
  5. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (Annual Exceedance Probability = 0.00143, MRI = 700 years).

Figure 1609.3(1) Ultimate Design Wind Speeds, VULT, For Risk Category II Buildings And Other Structures

### Shielding Factor

The table shown at right will assist you in calculating the total EPA for many of the popular luminaire configurations. Using the shielding factor to calculate total EPA prevents an over-designed pole being used, resulting in cost savings.

LUMINAIRE CONFIGURATION	EPA	SHIELDING FACTOR	TOTAL EPA
2 @ 180°	1.5	X 2.0	= 3.0
3 @ 180°	1.5	X 3.0	= 4.5
4 @ 180°	1.5	X 4.0	= 6.0
3 @ 120°	1.5	X 2.3	= 3.45 (Shielded)
4 @ 90°	1.5	X 3.2	= 4.8 (Shielded)

Example assumes a single luminaire EPA of 1.5.

- ASCE 7 Wind Load Design Assumptions:
- Risk Cat. II, MRI = 700 yrs., Exp. And Surface Roughness Cat. "C"
  - $K_{zt} = 1.0, K_d = 1.0, G = 1.14, V_{ASD} = \sqrt{0.6} \cdot V_{ULT}$  (2024 FBC 1609.3.1)
  - $C_f$  = Drag Coefficients calculated per AASHTO LTS-6 (ASCE 7-16 C29.4)
  - Strength Equations per AASHTO LTS-6 Allowable Stress Increase = 1.33 (ASCE 7-16 C29.4)

## FLORIDA BUILDING CODE GUIDE 2023 FBC EPA's

www.hapco.com

